

300712

2018-016

2017

--	--	--

--	--	--	--

	yfdb@fjyongfu.com	yfdb@fjyongfu.com
--	-------------------	-------------------

2

EPC

220V ±1100kV

1

.

2

220kV

3 EPC

EPC

EPC

3

1

2017	2016	
------	------	--


4

1

10

	26,632		22,102		0		0
10							
		29.98%	41,995,950	41,995,950			
		24.43%	34,216,716	34,216,716			
		5.46%	7,650,000	7,650,000			
-		4.85%	6,800,034	6,800,034			
		2.91%	4,080,000	4,080,000			
		2.49%	3,483,300	3,483,300			
		2.19%	3,073,000	3,060,000			
		2.18%	3,060,000	3,060,000			
		1.59%	2,225,922	0			
		0.51%	714,000	714,000			

3

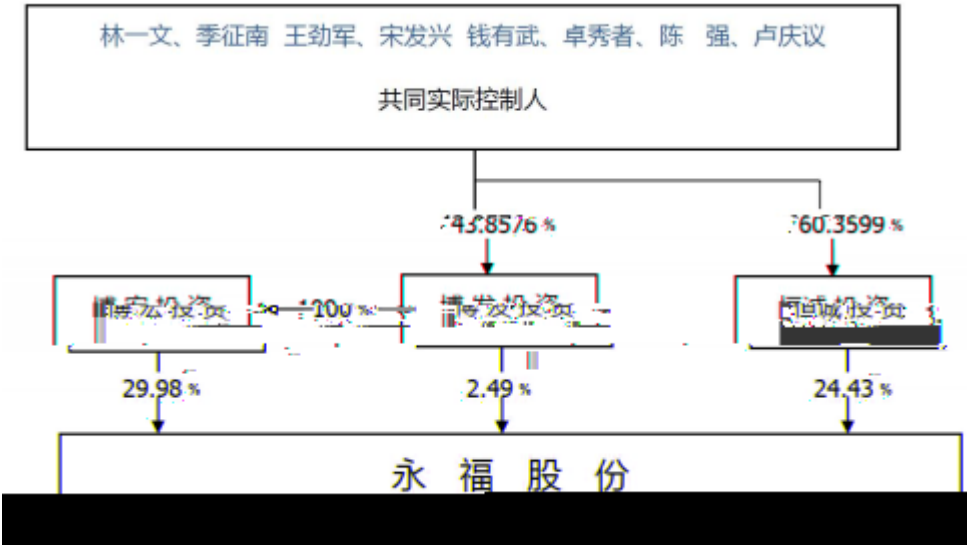

5

1

2017

6.9%

25,465.13	56,439.65	26.91%	
8,972.63	2.26%	EPC	30,573.99
	6.19%		7,696.61
			68.97%
			5.00%

1

	“ ”	2016-2020	2015-2020
136.88%			3304.64
	5,965.7	87.89%	2017

1.29 2017 F
2018

2 EPC
2016

2017 30,573.99 68.97%

1

8 19

2

HGIS

3

4

2

3 10%



EPC	305,739,894.67	45,249,956.07	14.80%	68.97%	47.39%	-2.17%
-----	----------------	---------------	--------	--------	--------	--------

4

5

6

7

1

42

16

2017

42

2017 5 28

2017

16

2017 6 12

2017 1

1

2017 1 1

2017

2017

1	“ ”	76,966,118.46
2		307,611.52
3	“ ”	2,341,154.17

2

3